




Industrial/Commercial Division
Fulton Boiler Works, Inc.

Fulton PulsePak Modulated Gas Pulse Combustion Heating Boilers


Relationship Between Efficiency And Return Water Temperature

% Efficiency
 Condensate Flow Lbs./Hr.
 °F Fluegas Temperature


PHW 300 LOW FIRE

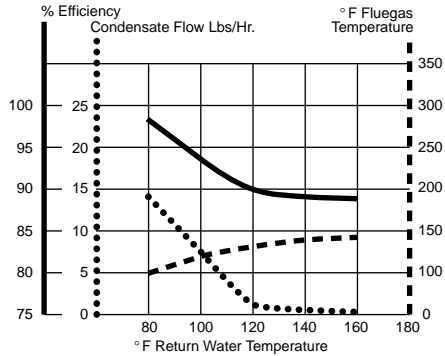


PHW 500 LOW FIRE

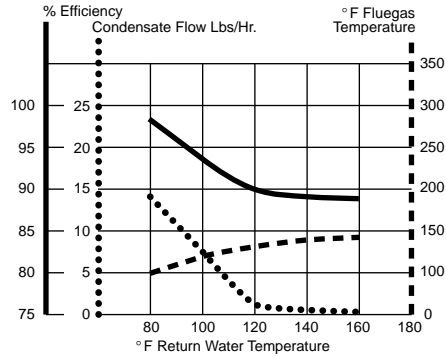


PHW 750 LOW FIRE

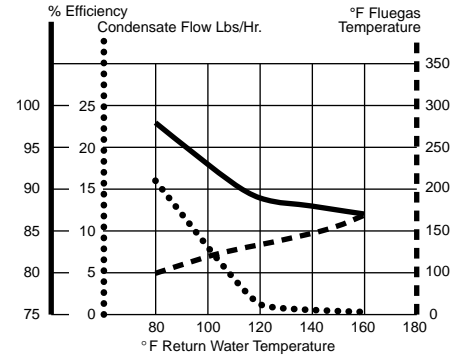


MID FIRE

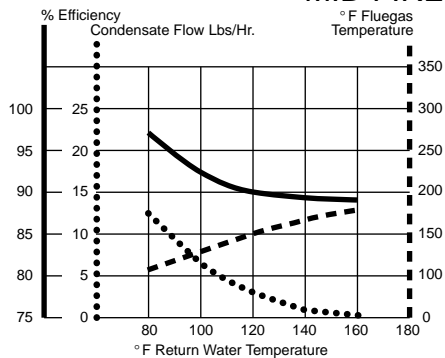


MID FIRE

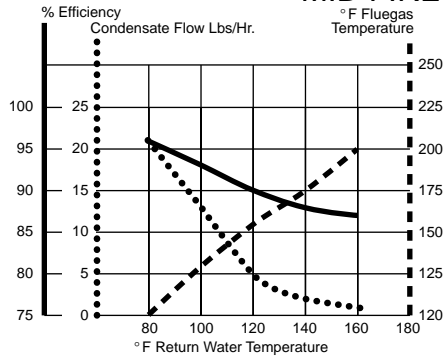


MID FIRE

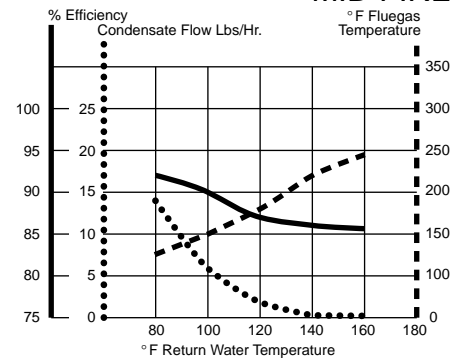


HIGH FIRE

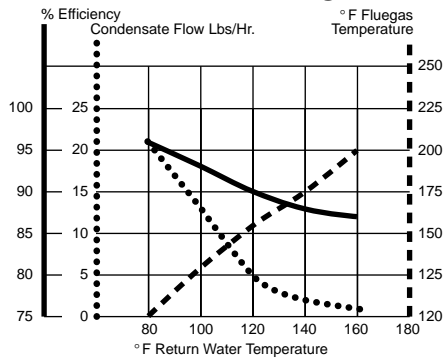


HIGH FIRE

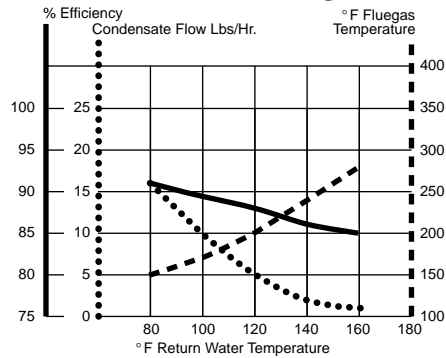


HIGH FIRE

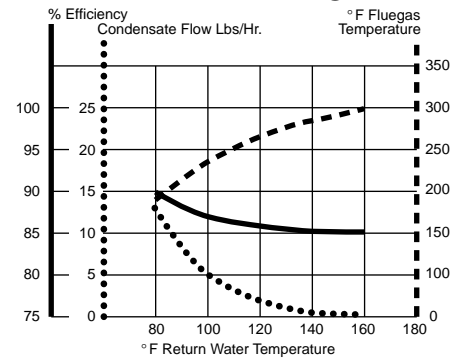


Pressure Loss Ft. Water

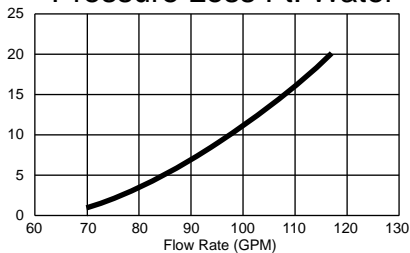

Pressure Loss Ft. Water

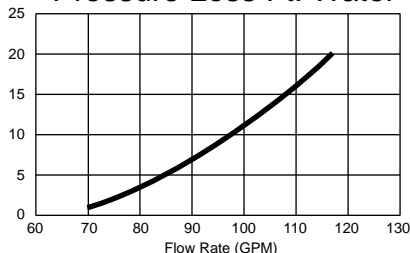

Pressure Loss Ft. Water

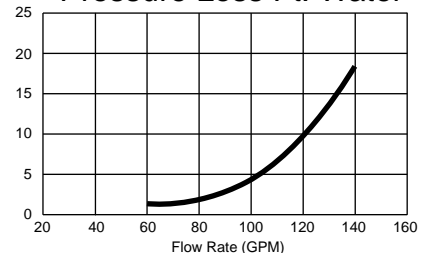



Industrial/Commercial Division
Fulton Boiler Works, Inc.

Fulton PulsePak Modulated Gas Pulse Combustion Heating Boilers

Relationship Between Efficiency And Return Water Temperature

% Efficiency
 Condensate Flow Lbs/Hr.
 °F Fluegas Temperature

